




Series UFR1405 10"-36" - Installation Instructions

Split 1400 Joint Restraint Gland with Gasket for Ductile Iron Pipe for New or Existing Pipe Installations


Refer to the Ford® website (www.fordmeterbox.com) for additional and most recent instructions and product information.

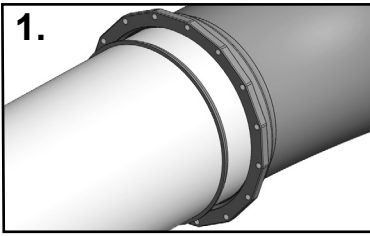



1. Clean the existing socket and pipe (for new installations, install pipe in socket according to pipe manufacturer's recommendations). Replace the existing gasket if necessary with a field-cut split gasket containing a single cut at a 45° angle as illustrated in Figure 1B. Thoroughly lubricate the gasket and pipe with an approved pipe lubricant meeting AWWA C111. Press the lubricated gasket firmly and evenly into the socket recess.

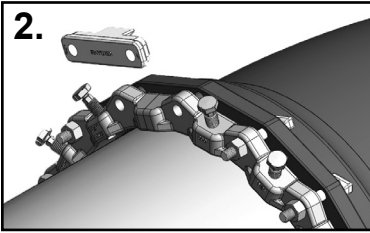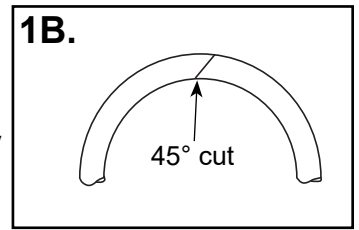



2. Place the UFR1405 split gland sections on the pipe with the lip extension oriented toward the socket. Orient the split in the gland 90° from the split in gasket. Loosely assemble the halves of the gland by installing the tee-head bolts hand tight in all solid holes.

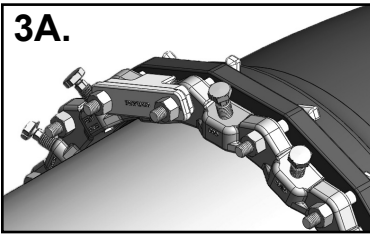


3. Connect the split gland halves with the longest portion of the connecting clamp facing the outside of the gland halves to be joined. Figure 3A. ("Uni-Flange" text on the connecting clamp should be exposed if properly installed. Figure 3B.) Insert the longer tee-head bolts through the clamps and hand tighten the nuts.

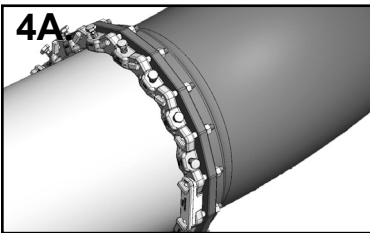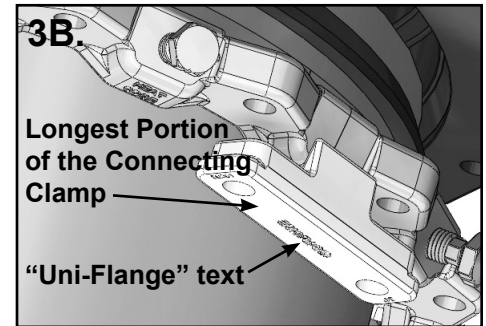

4. If using a split gasket, begin tightening the tee-head bolts to approximately 20-30 ft-lb on the side 180-degrees from the gasket split as shown in figure 4B. Then tighten the remaining bolts to approximately 20-30 ft-lb by working towards the split in the gasket. Complete tightening all the tee-head bolts to the torque recommended in AWWA C111 (75-90 ft-lbs on 4"-24" sizes, 100-120 ft-lbs in 30"-36" sizes) Tighten in an alternating manner, (6 o'clock, 12 o'clock, 3 o'clock, 9 o'clock) maintaining the same gap between the gland and the face of the MJ bell at all points around the socket. Repeat the process until all bolts are within the recommended torque range. Use of a torque wrench is highly recommended and required to ensure proper torque.

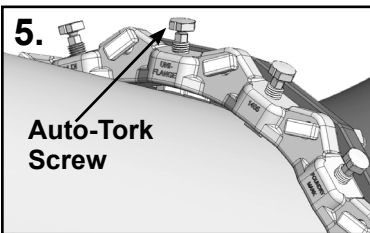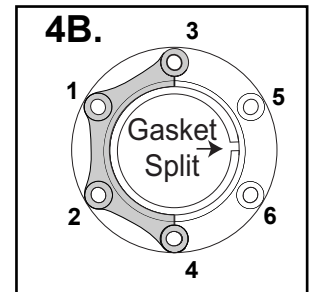

5. After correct assembly of the mechanical joint, bring all wedges in contact with the pipe surface by turning the Auto-Tork actuating screws in a clockwise direction until the screws are hand tight.

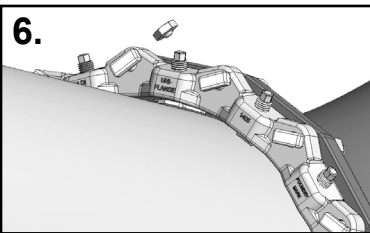

6. Tighten each Auto-Tork actuating screw by turning approximately 180° (1/2 turn), alternating among screws until the break away heads twist off. Use a torque wrench to ensure a torque of 75-110 ft-lbs has been applied to actuating screws. Note: To re-use or re-install after the Auto-Tork break-off heads have been removed; tighten the 5/8" hex head of the actuating screw to 75 ft-lbs. Although not a requirement, it is always a good practice to recheck the tee-head bolt torque prior to backfilling.