


# The Meter Setter



## The New FACC Provides Extra Peace Of Mind

When a water service is abandoned, it is a straightforward task of excavating the service line, shutting off the corporation stop, removing the service line, and filling the trench...or is it that simple? What if the corporation stop fails to completely seal off after years of sitting in an open position? What if a leak develops during the excavation or backfill process? Then the task takes on new complications.

The FACC Abandoned Corp Cap solves this problem. The Ford FACC provides a quick and easy way to encapsulate corporation stops that are no longer used, without the need to interrupt water service.

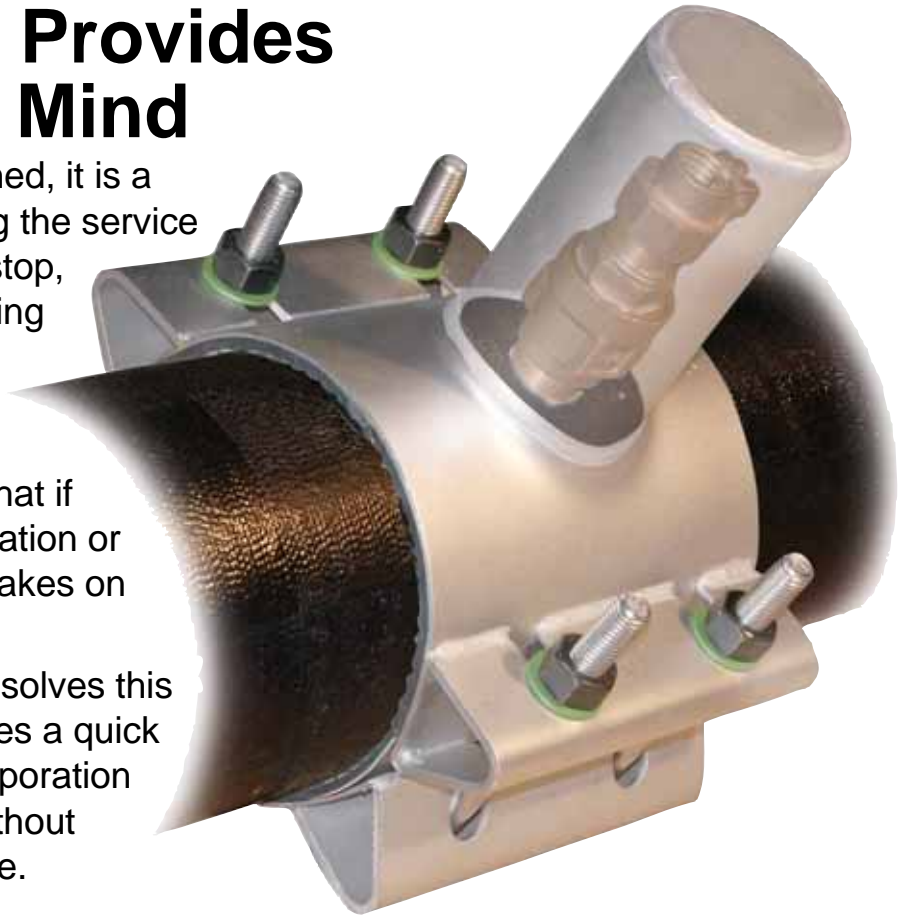

### **The Ford FACC Abandoned Corp Cap offers the following features:**

- 18-8 type 304 stainless steel construction
- 18-8 type 304 stainless steel hardware
- Gridded SBR full pad gasket
- Buna-N outlet gasket
- 3" diameter cap to encapsulate 1/2" through 1" corporation stops
- Optional test port
- Accommodates nominal pipe sizes 4" through 12"
- Rated for 300 psi working pressure

For more information on the Ford FACC Abandoned Corp Cap, contact your local Ford Distributor or the Ford Meter Box Company.



The Ford Meter Box Company, Inc., P.O. Box 443, Wabash, Indiana, USA 46992-0443  
Telephone: 260-563-3171 FAX: 800-826-3487 Overseas FAX: 260-563-0167 <http://www.fordmeterbox.com>