

SUBMITTAL INFORMATION





PACK JOINT FOR PVC INLET BY METER YOKE NOSE OUTLET

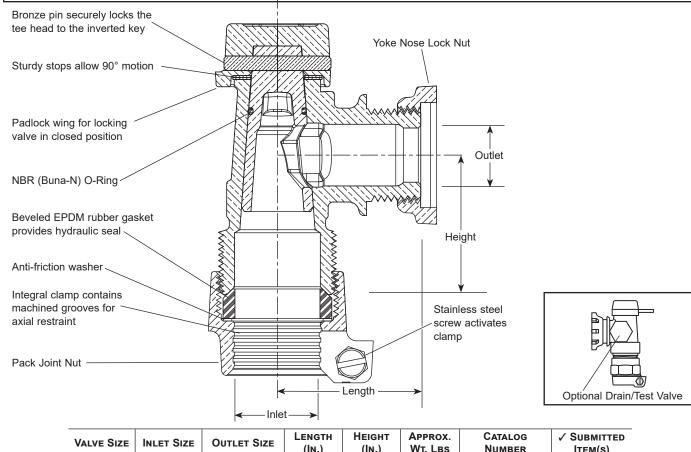

VALVE SIZE	INLET SIZE	OUTLET SIZE	LENGTH (In.)	HEIGHT (In.)	APPROX. Wt. Lbs	Catalog Number	✓ SUBMITTED ITEM(S)
3/4"	3/4"	5/8"	1-13/16	1-3/4	1.6	AV97-313W-NL	
3/4"	3/4"	5/8"x3/4" & 3/4"	1-13/16	1-3/4	1.6	AV97-323W-NL	

Note: Ford Pack Joints for PVC are only recommended for Schedule 40 and Schedule 80 pipe.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Certified to NSF/ANSI/CAN Standard 61 and NSF/ANSI/CAN Standard 372 where applicable
- · Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Meets 100 PSI working pressure requirement of AWWA Standard C800
- Padlock wing for locking the valve in a closed position
- EPDM rubber yoke nose gasket sold separately: GT-112 (5/8"), GT-118 (3/4") and GT-123 (1")
- Optional Drain/Test Valve is available. Change "W" to "D" in the catalog number

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.

11/14/24



