



SUBMITTAL INFORMATION

Angle Ball Flange Meter Valves - (BFA63-xxxWR-IDR9-AWT-NL style)



PACK JOINT FOR POLYETHYLENE PIPE (IDR9 PEP) INLET BY METER FLANGE OUTLET

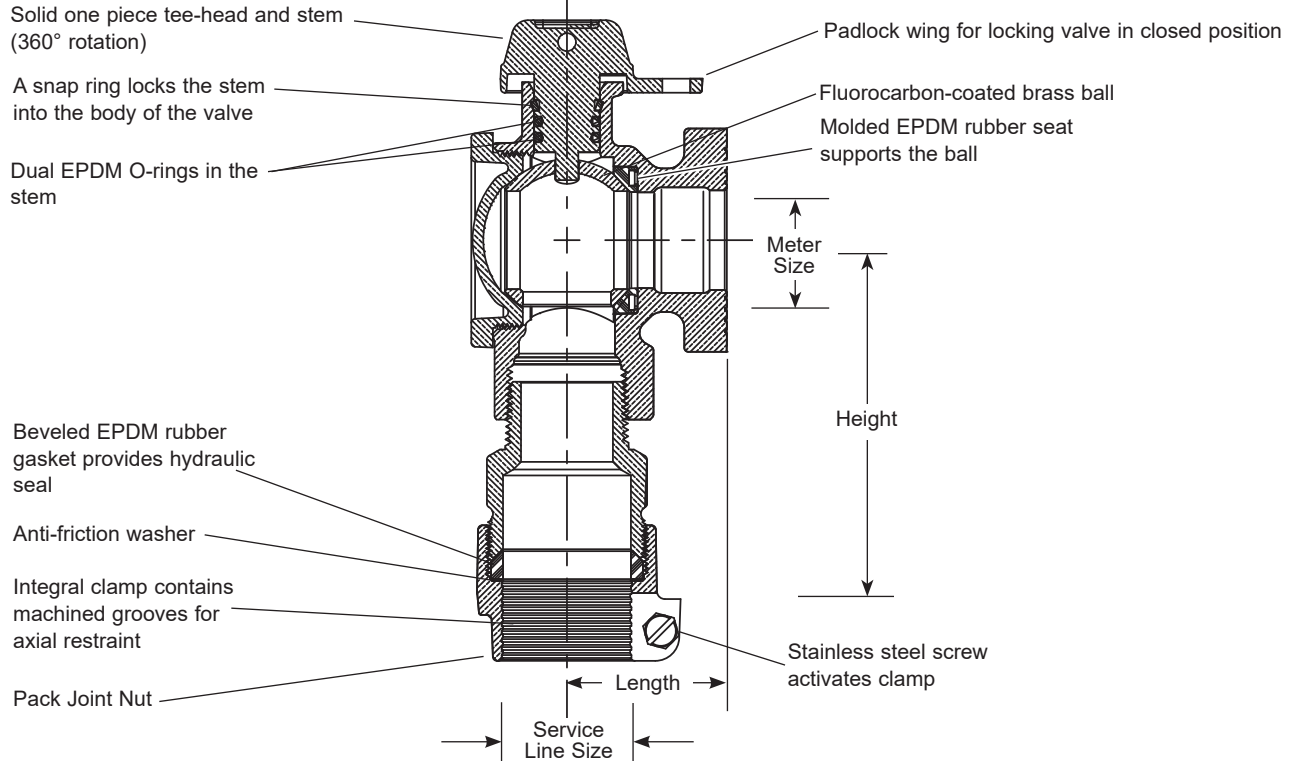

Due to design variations related to sizing, items may differ from images above.

VALVE SIZE	SERVICE LINE SIZE INLET	METER SIZE OUTLET	LENGTH	HEIGHT	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
1-1/2"	1-1/2"	1-1/2"	2-1/2"	4-31/32"	9.4	BFA63-666WR-IDR9-AWT-NL	
2"	2"	1-1/2" & 2"	2-13/16"	5-21/32"	16.2	BFA63-777WR-IDR9-AWT-NL	

Note: Ford recommends using insert stiffeners with plastic pipe or tubing.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Valve is non-directional and is watertight with flow in either direction
- Hole for attaching handle is provided in the tee-head
- 300 PSI working pressure in either direction
- Includes EPDM drop-in style meter gasket
- Padlock wing for locking valve in closed position
- Suitable for customer side shut off (outlet side of meter) up to 300 PSI
- Slotted holes are standard on 2" Flanged Meter Valves, allowing 1-1/2" Flange Meter connection
- Ends are integral or secured with adhesive to prevent unintentional disassembly

Optional: Meter support brackets. Add "-MSB" to the end of the part number

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

03/04/21

Submitted By: