



SUBMITTAL INFORMATION

Corporation Stop Assembly - (F1000-x-U-ANWT-NL style)



AWWA/CCTAPER THREAD INLET BY ULTRA-TITE (CTS) COUPLING ASSEMBLED TO CORPORATION STOP OUTLET NOT WATERTIGHT

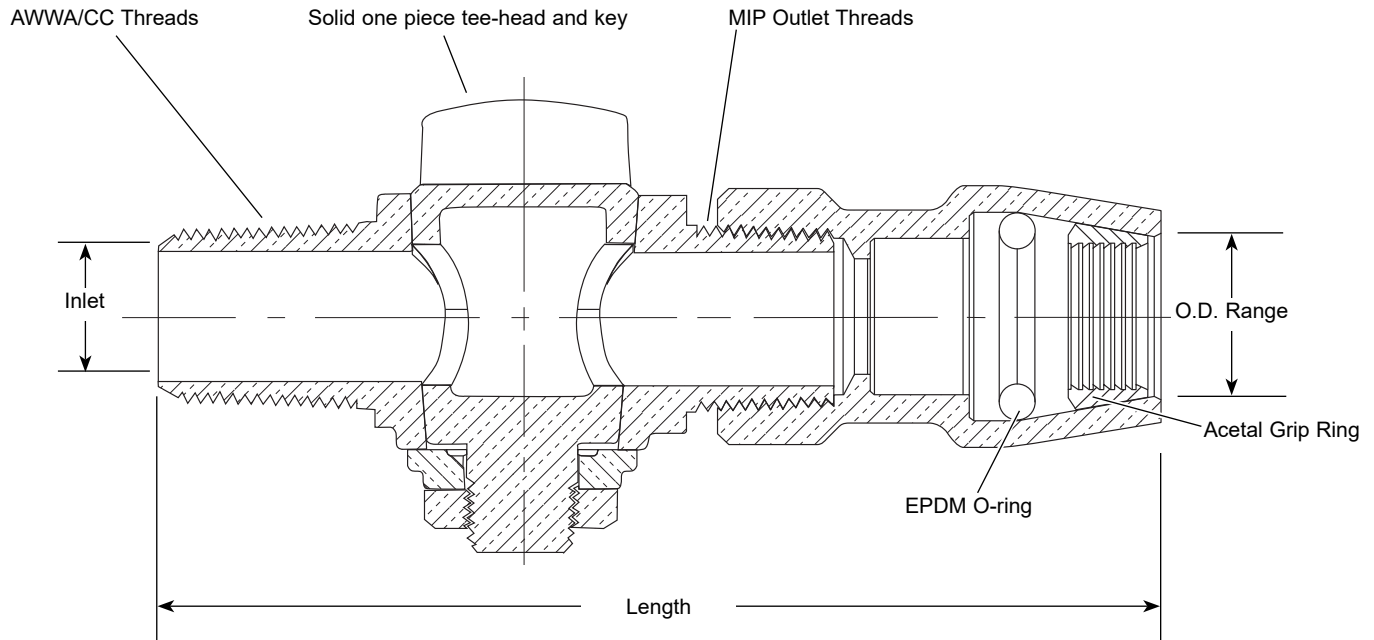

VALVE SIZE	INLET SIZE	ULTRA-TITE OUTLET O.D. RANGE (IN.)	VALVE LENGTH	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	0.871 - 0.879	5-15/16"	1.9	F1000-3-U-ANWT-NL	
1"	1"	1.120 - 1.130	6-3/4"	2.9	F1000-4-U-ANWT-NL	

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Body design provides larger, more rugged wrench flats for proper installation
- Meets 100 PSI working pressure requirement of AWWA Standard C800
- Ultra-Tite fitting is not assembled watertight to corporation stop, for tapping purposes
- Unless otherwise requested, corporation stops with Ultra-Tite connections require a drilling/tapping (insertion) machine adapter for male iron pipe outlet threads. Contact the factory for Ultra-Tite corporation stops with optional outlet thread connections

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

www.fordmeterbox.com

06/03/17

Submitted By: