



SUBMITTAL INFORMATION

Corporation Stop Assembly - (F1001-x-U-ANWT-NL style)



AWWA/CC TAPER THREAD INLET BY ULTRA-TITE FOR POLYETHYLENE PIPE (SIDR7 PEP) COUPLING ASSEMBLED TO CORPORATION STOP OUTLET (NOT WATERTIGHT)

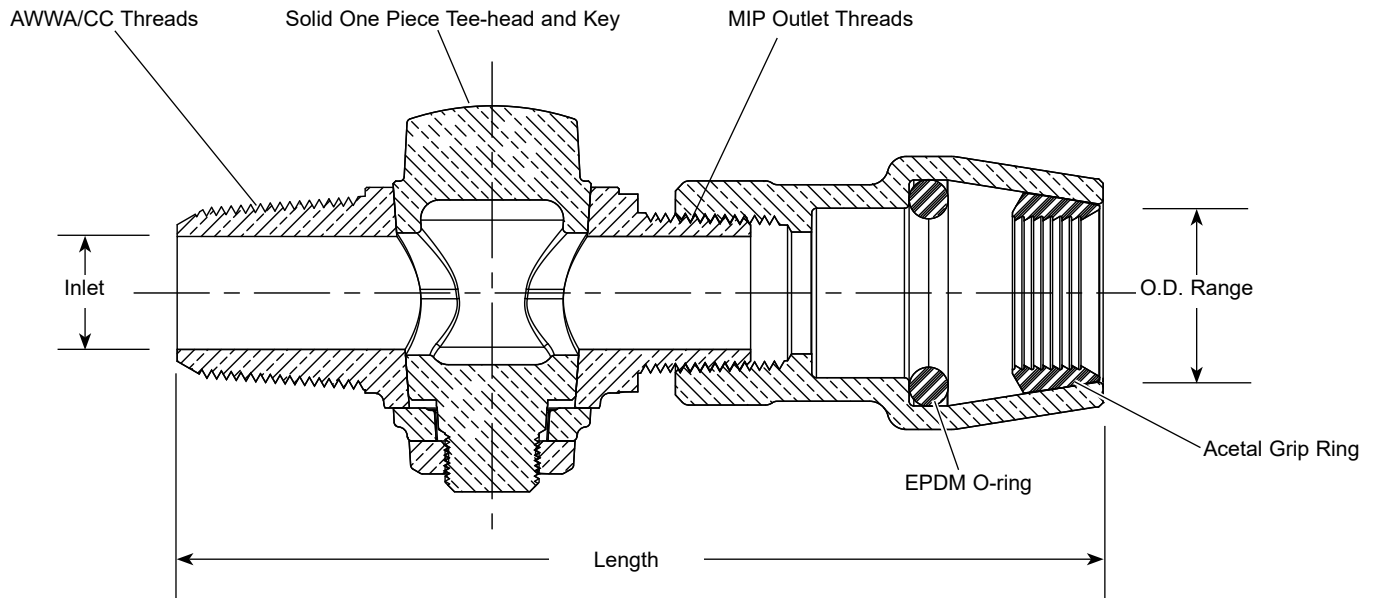

Due to design variations related to sizing, items may differ from images above.

VALVE SIZE	INLET SIZE	ULTRA-TITE OUTLET O.D. RANGE	VALVE LENGTH	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	1.045 - 1.110	6-5/32"	2.1	F1001-3-U-ANWT-NL	
1"	1"	1.329 - 1.399	6-7/8"	3.1	F1001-4-U-ANWT-NL	

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Body design provides larger, more rugged wrench flats for proper installation
- Meets 100 PSI working pressure requirement of AWWA Standard C800
- Ultra-Tite fitting is not assembled watertight to corporation stop, for tapping purposes

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

03/05/20

Submitted By: