



# SUBMITTAL INFORMATION

Pitorifice Key Corporation Stops - (F400-4-P-NL style)



AWWA/CC TAPER THREAD INLET BY MALE IRON PIPE THREAD OUTLET

COPPER PITORIFICE ON INLET

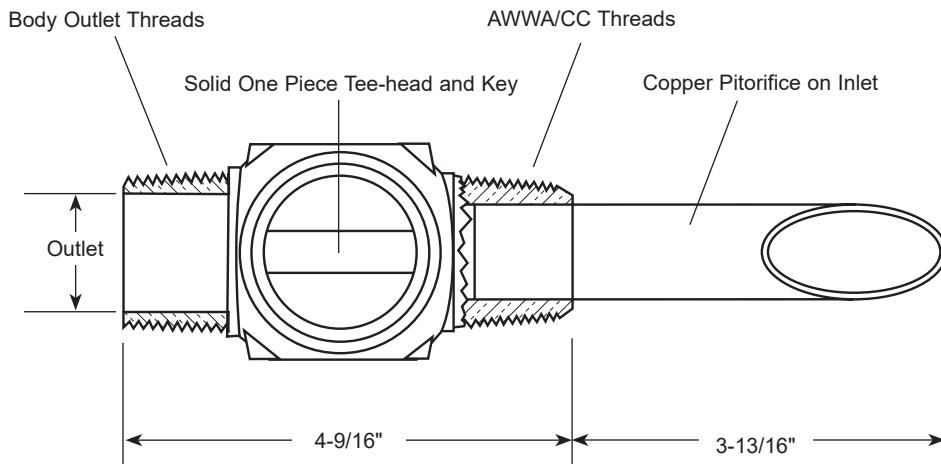

| VALVE SIZE | INLET SIZE | OUTLET SIZE | BODY OUTLET THREADS | APPROX. WT. LBS | PART NUMBER | ✓ SUBMITTED ITEM(S) |
|------------|------------|-------------|---------------------|-----------------|-------------|---------------------|
| 1"         | 1"         | 1"          | 1" MIP              | 3.2             | F400-4-P-NL |                     |

## FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- Certified to NSF/ANSI Standard 61 and NSF/ANSI Standard 372 where applicable
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Body design provides larger, more rugged wrench flats for proper installation
- Meets 100 PSI working pressure requirement of AWWA Standard C800

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



**The Ford Meter Box Company, Inc.**  
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443  
Phone: 260-563-3171 / Fax: 800-826-3487  
Overseas Fax: 260-563-0167  
[www.fordmeterbox.com](http://www.fordmeterbox.com)

Submitted By:

09/08/25