



SUBMITTAL INFORMATION

Ballcorp Corporation Stops - (FB1100-x-U-ANWT-NL style)



MALE IRON PIPE THREAD INLET BY ULTRA-TITE FOR POLYETHYLENE TUBING (CTS) OUTLET

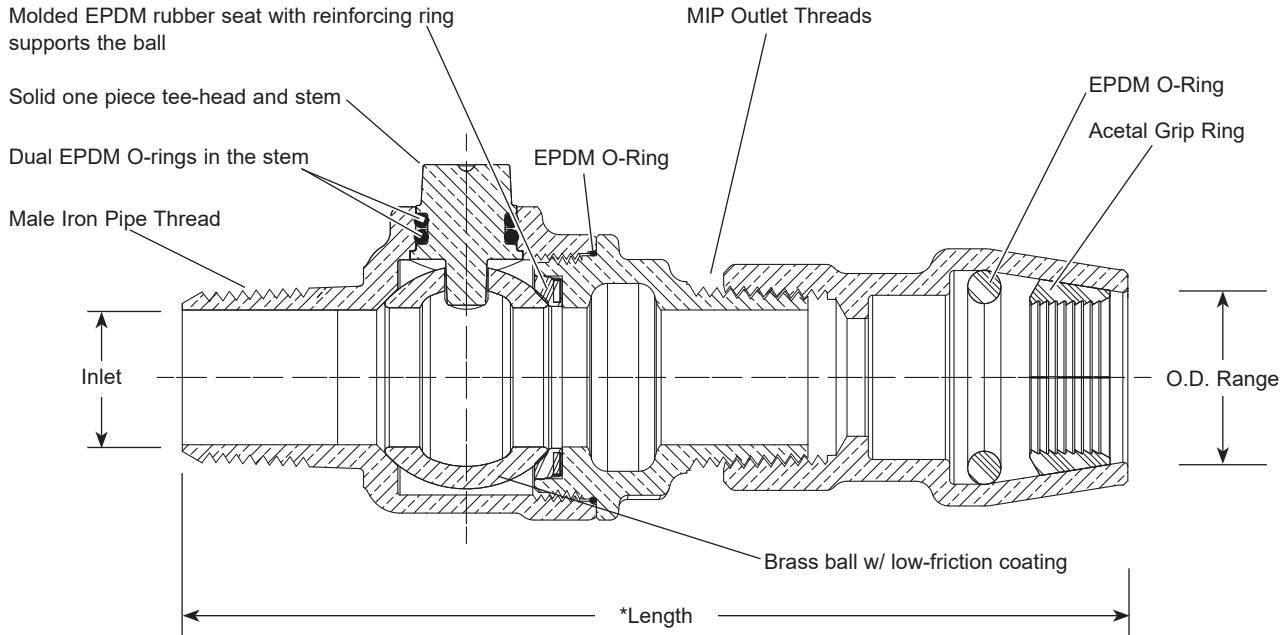

VALVE SIZE	INLET SIZE	OUTLET SIZE UT FOR CTS PE	VALVE LENGTH	BODY OUTLET THREADS	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	0.871-0.879	6-3/8"	3/4" MIP	1.7	FB1100-3-U-ANWT-NL	
1"	1"	1.120-1.130	6-53/64"	1" MIP	2.3	FB1100-4-U-ANWT-NL	

*Indicates fully assembled valve length.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Ends are integral or secured with adhesive to prevent unintentional disassembly
- Ultra-Tite connections assembled non-watertight
- 300 PSI working pressure
- Unless otherwise requested, corporation stops with Ultra-Tite connections require a drilling/tapping (insertion) machine adapter for male iron pipe outlet threads. Contact the factory for Ultra-Tite corporation stops with optional outlet thread connections

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

Submitted By:

06/01/17