


# SUBMITTAL INFORMATION

## Ballcorp Corporation Stops - (FB1101-x-U2-ANWT-NL style)



### MALE IRON PIPE THREAD INLET BY ULTRA-TITE FOR POLYETHYLENE PIPE (IPS) OUTLET, ASSEMBLED NON-WATERTIGHT

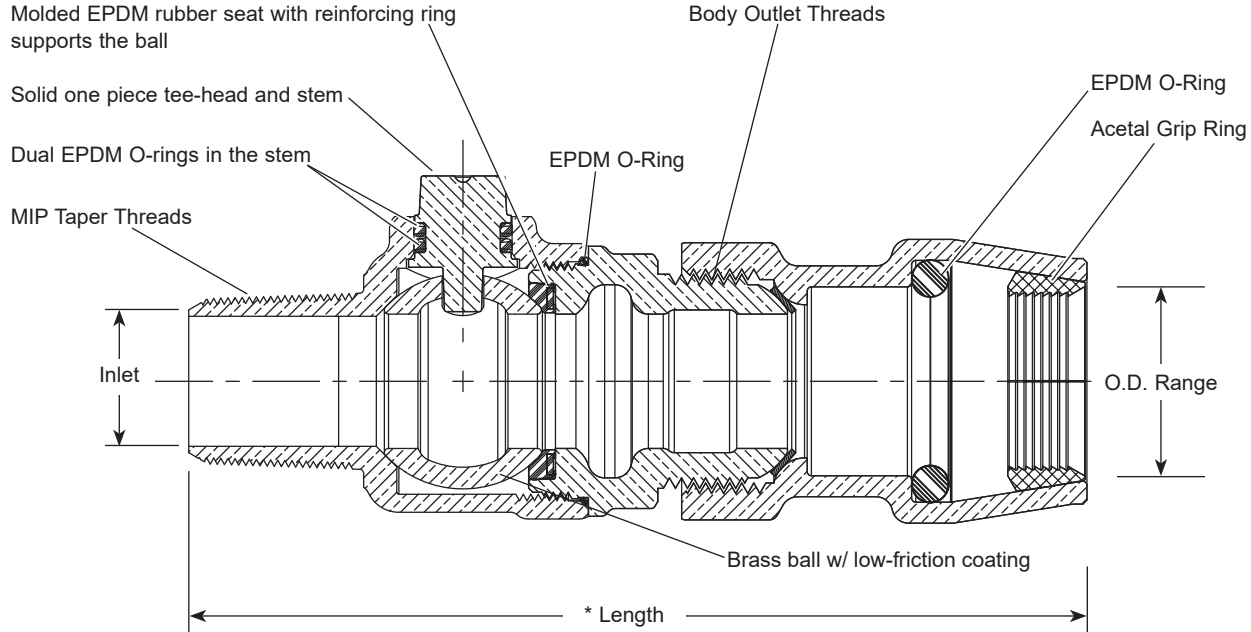


Image shown above is an FB1101-4-U2-ANWT-NL.

VALVE SIZE	INLET SIZE	OUTLET SIZE UT FOR IPS PE	VALVE LENGTH	BODY OUTLET THREADS	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	1.045-1.110	6-13/32"	3/4" Flare Copper	2.0	FB1101-3-U2-ANWT-NL	
1"	1"	1.329-1.399	6-23/32"	1" Flare Copper	2.9	FB1101-4-U2-ANWT-NL	

\* Indicates fully assembled valve length

## FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Ends are integral or secured with adhesive to prevent unintentional disassembly
- Ultra-Tite connections assembled non-watertight, for tapping purposes
- 300 PSI working pressure

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



### The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

www.fordmeterbox.com

05/31/24

Submitted By: