



SUBMITTAL INFORMATION


Repair Clamps - (FS3-xxxx-Length-EPDM style)



THREE SECTION ALL STAINLESS STEEL REPAIR CLAMPS WITH EPDM GASKET

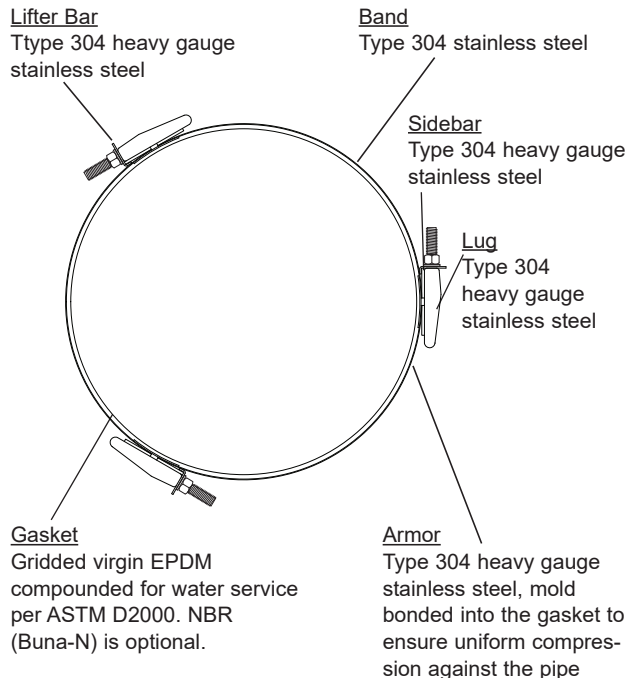


Bolts & Nuts
Type 304 stainless steel nuts and washers per ASTM A193 and A194. Nuts are coated to prevent galling.

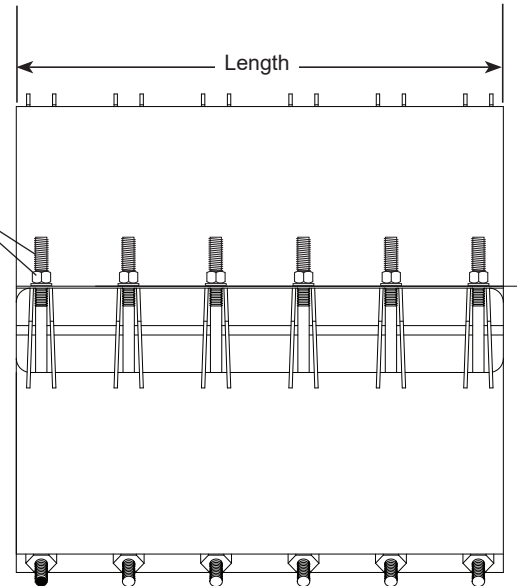

OUTLET THREAD TAP CODE

CC (AWWA) Thread		IP Thread	
Thread	Code No.	Thread	Code No.
3/4" CC	-CC3	3/4" IP	-IP3
1" CC	-CC4	1" IP	-IP4
1-1/4" CC	-CC5	1-1/4" IP	-IP5
1-1/2" CC	-CC6	1-1/2" IP	-IP6
2" CC	-CC7	2" IP	-IP7

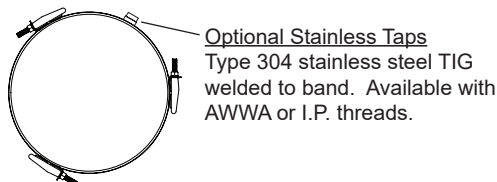

Nom. Pipe Size	Pipe O.D. Range (in.)	Length and Approx. Weight (lbs.)					Bolt Size	Band Thickness	Catalog Number	✓ Submitted Item		
		12.5"	15"	20"	24"	30"						
16"	15.92 - 17.12	31	40	52	64	77	5/8" 11 UNC	20 GA.	FS3-1712-Length-EPDM			
	17.10 - 18.30								FS3-1830-Length-EPDM			
18"	18.00 - 19.20	35	44	56	68	84			FS3-1920-Length-EPDM			
	18.78 - 19.98								FS3-1998-Length-EPDM			
	19.50 - 20.70								FS3-2070-Length-EPDM			
20"	21.60 - 22.80	41	48	60	73	89			FS3-2280-Length-EPDM			
	22.80 - 24.00								FS3-2400-Length-EPDM			
24"	24.45 - 25.65	46	53	65	79	102			FS3-2565-Length-EPDM			
	25.80 - 27.00								FS3-2700-Length-EPDM			
30"	29.62 - 30.82	51	58	69	83	108			FS3-3082-Length-EPDM			
	31.22 - 32.42								FS3-3242-Length-EPDM			
Number of studs		12	12	18	21	27						

FEATURES

- Optional outlet taps are available for repair of service line pull-outs. Add tapping code to catalog number
- All welds are fully passivated to restore corrosion resistant characteristics of stainless steel
- Certified to ANSI/NSF Standard 61

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

06/02/22

Submitted By: