



SUBMITTAL INFORMATION

Lead-Pak Coupling - (Q34-xx-NL style)



PACK JOINT FOR COPPER OR PLASTIC TUBING (CTS) BY LEAD PIPE

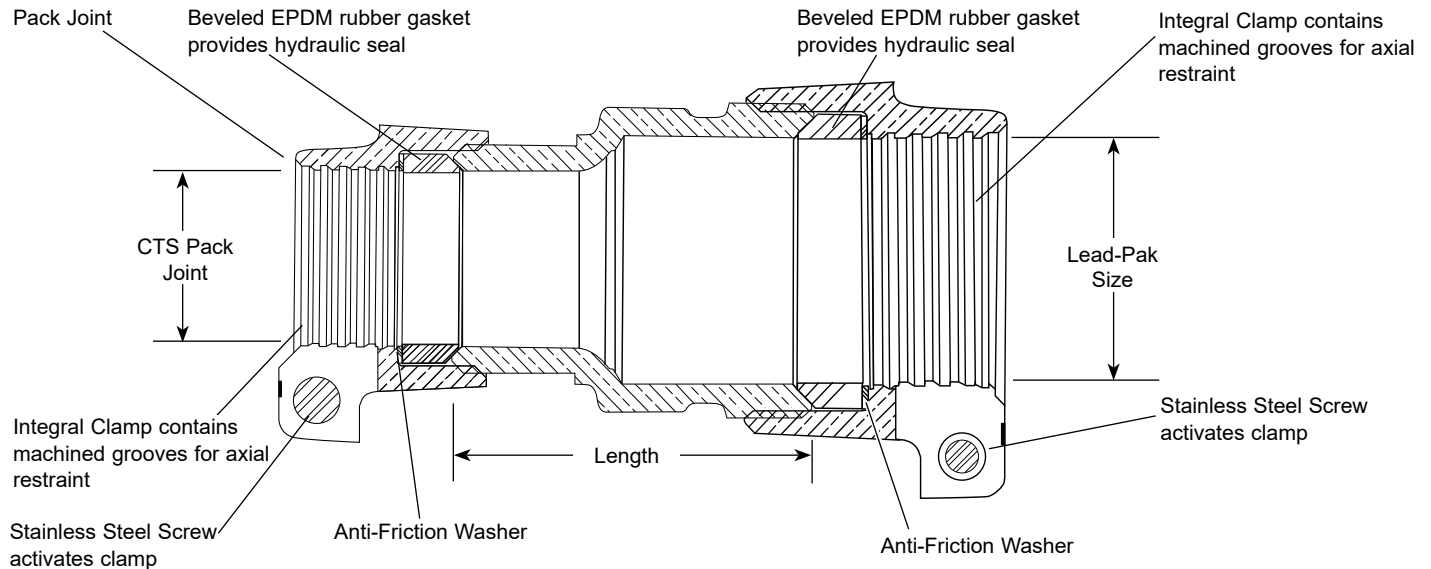

Q34-44-NL pictured above

DESCRIPTION		LENGTH	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
CTS PJ SIZE	LEAD-PAK SIZE				
1"	5/8" dbl. extra strong lead (xxs)	2-1/8"	1.1	Q34-24-NL	
3/4"	3/4" dbl. extra strong lead (xxs)	2-1/2"	1.6	Q34-33-NL	
3/4"	1" dbl. extra strong lead (xxs)	2-3/8"	1.6	Q34-43-NL	
1"	1" dbl. extra strong lead (xxs)	2-3/8"	1.7	Q34-44-NL	

Note: Ford recommends using insert stiffeners with plastic pipe or tubing.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Certified to NSF/ANSI Standard 61 and NSF/ANSI Standard 372 where applicable
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

08/16/19

Submitted By: