



SUBMITTAL INFORMATION

Service Insulator Corporation Stops - (SI-FB1000-7-AWT-NL style)



AWWA/CC TAPER THREAD INLET BY SERVICE INSULATOR BY PACK JOINT FOR COPPER OR PLASTIC TUBING (CTS) OUTLET, ASSEMBLED WATERTIGHT

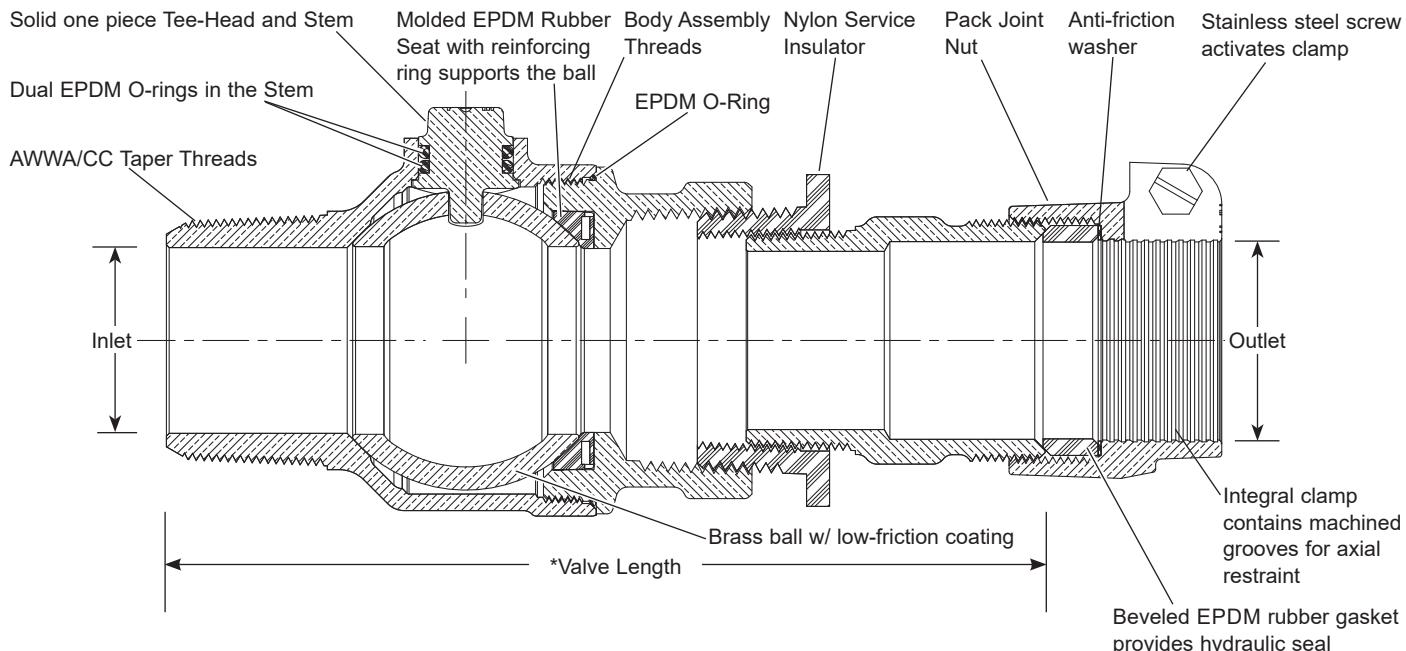

VALVE SIZE	ASSEMBLY INLET SIZE	ASSEMBLY OUTLET SIZE	LENGTH (IN.)	APPROX. WT. LBS	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
2"	2"	2"	9-9/16	10.2	SI-FB1000-7-AWT-NL	

Note: Ford recommends using insert stiffeners with plastic pipe or tubing.

*Indicates fully assembled valve length.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Corporation Stop body assembly threads are secured with adhesive to prevent unintentional disassembly
- Solid one piece tee-head and stem with EPDM O-rings in stem
- Molded EPDM seat supports the ball
- Nylon service insulator provides protection against service line electrolysis
- 300 PSI working pressure

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
 P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
 Phone: 260-563-3171 / Fax: 800-826-3487
 Overseas Fax: 260-563-0167
www.fordmeterbox.com

Submitted By: