



SUBMITTAL INFORMATION

Service Insulator Corporation Stops - (SI-FB500-7-AWT-NL style)



MALE IRON PIPE INLET BY SERVICE INSULATOR BY MALE IRON PIPE OUTLET

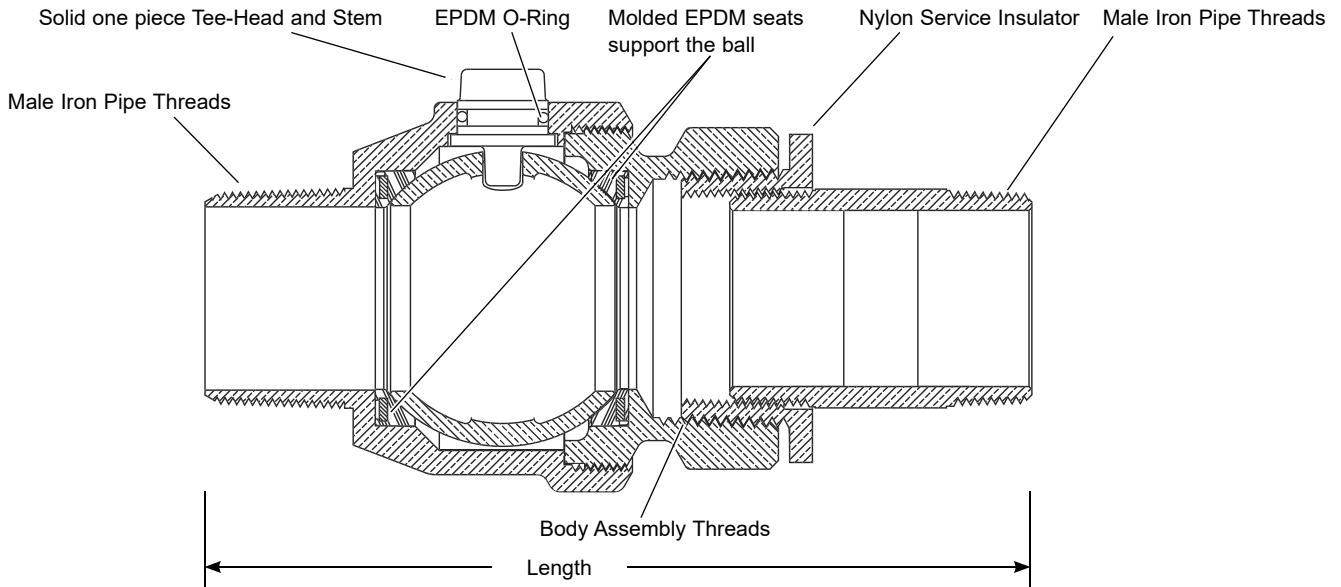

VALVE SIZE	ASSEMBLY INLET SIZE	ASSEMBLY OUTLET SIZE	APPROX. LAYING LENGTH	APPROX. WT. LBS	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
2"	2"	2"	9"	9.6	SI-FB500-7-AWT-NL	

FEATURES

- All brass components that come in contact with potable water conform to AWWA Standard C800 (UNS NO C89833)
- The product has the letters "NL" cast into the main body for proper identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
- Corporation Stop body assembly threads are secured with adhesive to prevent unintentional disassembly
- Solid one piece tee-head and stem with EPDM O-ring in stem
- Molded EPDM seats support the ball
- Fluorocarbon-coated brass ball
- Nylon service insulator provides protection against service line electrolysis
- 300 PSI working pressure

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

<http://www.fordmeterbox.com>

01/20/14

Submitted By: