



SUBMITTAL INFORMATION

Pack Joint Tee - (T777-xxx-AWT-NL style)



PACK JOINT FOR PVC PIPE TO PACK JOINT FOR PVC PIPE BY PACK JOINT FOR PVC PIPE
ASSEMBLED WATERTIGHT

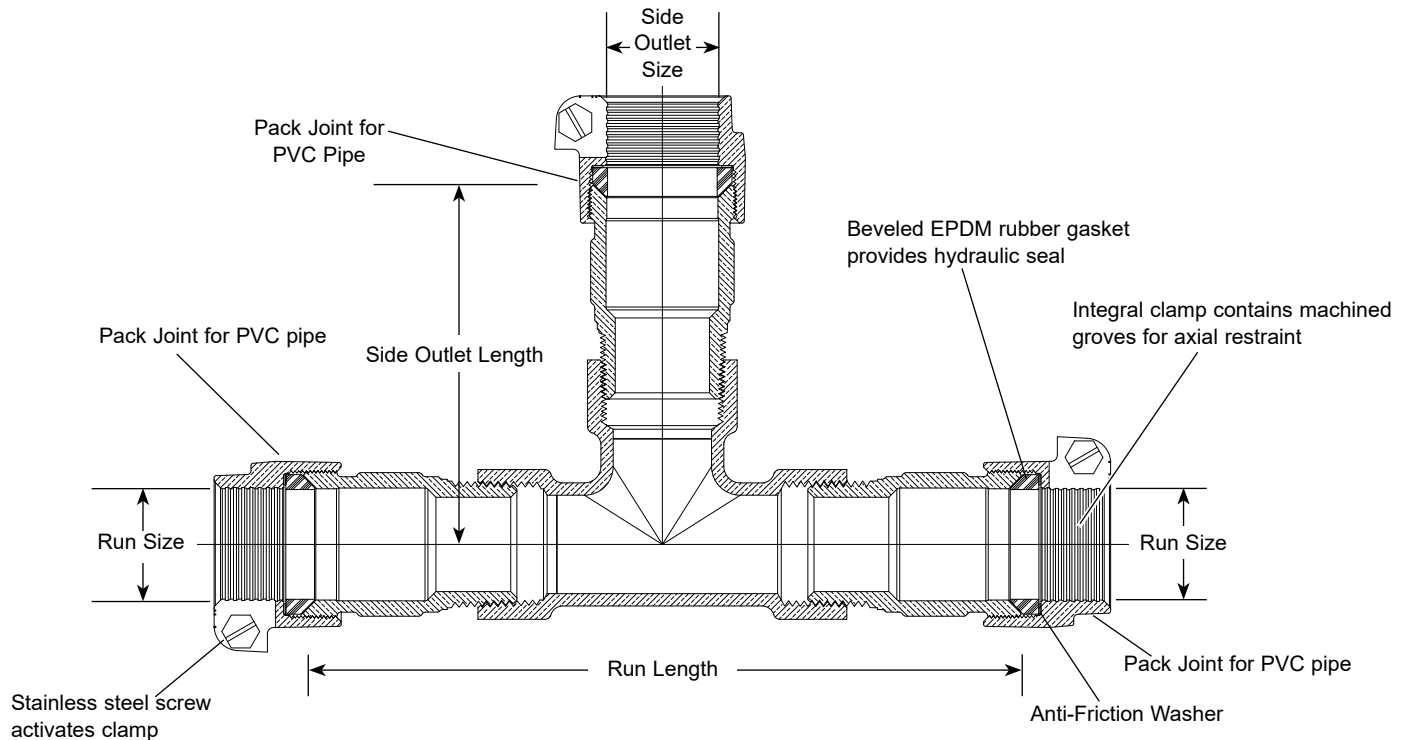

Due to design variations related to sizing, items may differ from images above.

BOTH ENDS (RUN SIZE)	SIDE OUTLET SIZE	RUN LENGTH	SIDE OUTLET LENGTH	APPROX WT. LBS.	PART NUMBER	✓ SUBMITTED ITEM(S)
1-1/4"	1-1/4"	10-15/16"	5-15/32"	9.6	T777-555-AWT-NL	
1-1/2"	1-1/2"	9-15/16"	5"	9.9	T777-666-AWT-NL	

Note: Ford Pack Joints for PVC pipe are recommended for only Schedule 40 and Schedule 80 PVC pipe or DR-11 HDPE pipe with appropriate insert stiffener.

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Ends are integral or secured with adhesive to prevent unintentional disassembly

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

www.fordmeterbox.com

05/26/21

Submitted By: