



# SUBMITTAL INFORMATION

## Pack Joint Tee - (T777-xxx-NL style)



PACK JOINT FOR PVC PIPE TO PACK JOINT FOR PVC PIPE BY PACK JOINT FOR PVC PIPE

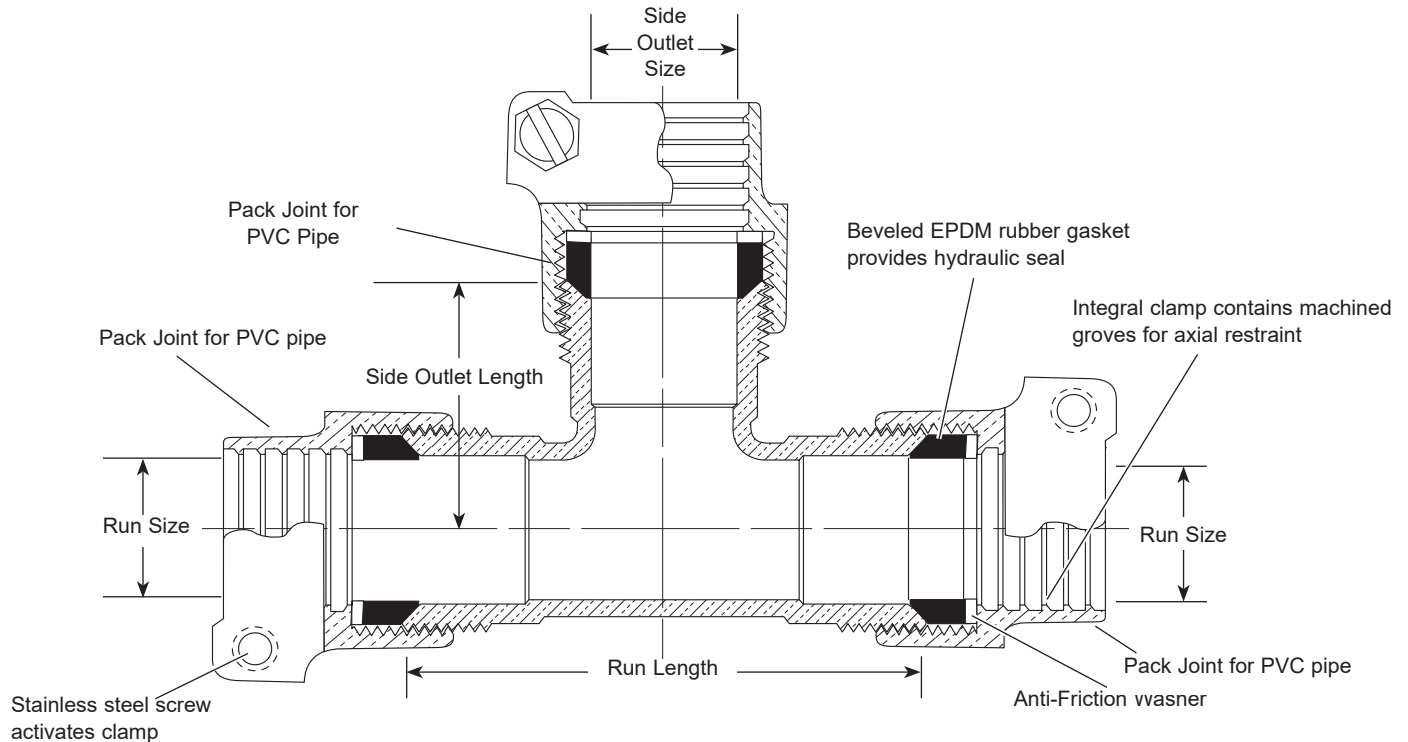

BOTH ENDS (RUN SIZE)	SIDE OUTLET SIZE	RUN LENGTH (IN.)	SIDE OUTLET LENGTH (IN.)	APPROX Wt. LBS.	PART NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	3-3/4	1-15/16	1.4	T777-333-NL	
1"	1"	4-3/4	2-1/4	1.9	T777-444-NL	
2"	2"	7-3/8	3-11/16	6.0	T777-777-NL	

**Note:** Ford Pack Joints for PVC pipe are recommended only for Schedule 40 and Schedule 80 PVC pipe, or DR11 HDPE pipe with appropriate insert stiffener.

### FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Certified to NSF/ANSI/CAN Standard 61 and NSF/ANSI/CAN Standard 372 where applicable
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



#### The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

[www.fordmeterbox.com](http://www.fordmeterbox.com)

02/20/25

Submitted By: