



SUBMITTAL INFORMATION

80 Series Tandem Coppersetter - (TVBHCCR84-18W-22-44-FP-NL style)

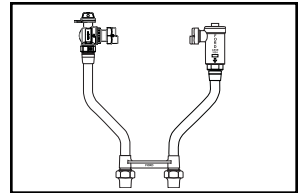

FULL PORT ANGLE BALL VALVE BY CHLORAMINE RESISTANT ANGLE CARTRIDGE DUAL CHECK VALVE (1" METER)


FLARE COPPER INLET AND OUTLET

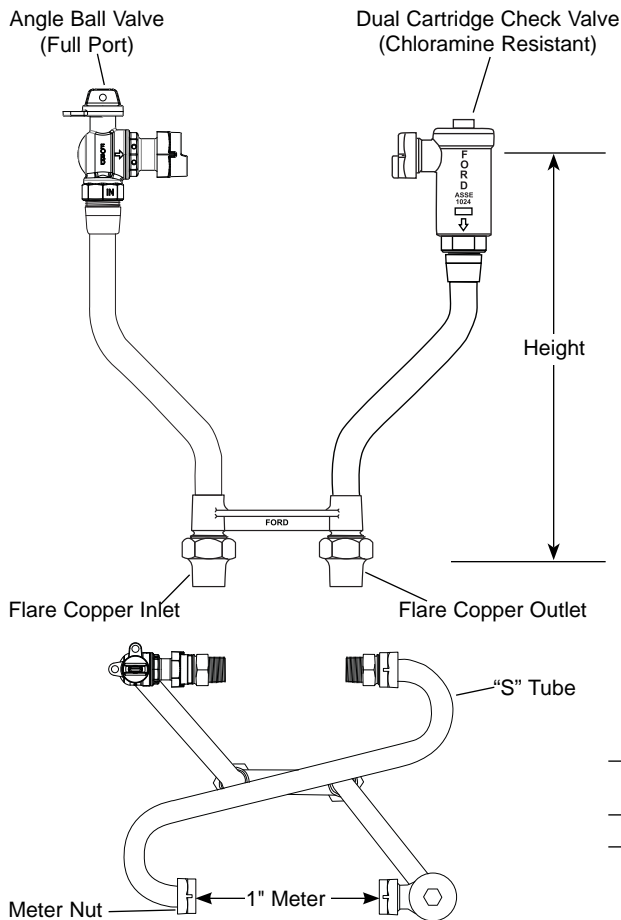

Coppersetter Part Number

HEIGHT	APPROX. WT. LBS.	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
18"	15	TVBHCCR84-18W-22-44-FP-NL	

Adapters for Regulator (MIP by Male Meter Thread)



CATALOG NUMBER	METER SIZE	ADAPTER LENGTH	APPROX. WT. LBS.
RA-4-NL	1"	2-1/4"	1.3

Service Line Size

INLET	OUTLET	SERVICE LINE CONN. SIZE	✓ SUBMITTED ITEM(S)
1" Flare Copper	1" Flare Copper	44	

FEATURES

- All brass components that come in contact with potable water conform to AWWA Standard C800 (UNS NO C89833)
- The product has the letters "NL" cast into the main body for proper identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
- Dual Cartridge Check Valve is ASSE 1024 approved
- 1-1/8" Copper Risers provide more flow capacity.
- All Ford Setters are assembled with lead-free solder.
- Unless specified otherwise, Tandem Coppersetters are designed to hold a water meter in series with a pressure regulator.
- Tandem Coppersetters include an "S" tube and a pair of male iron pipe by male meter thread regulator adapters for holding a pressure regulator.
- Copper conforms to ASTM B-88, Copper Alloy #122.
- Full port inlet ball valve
- Chloramine resistant rubber and plastic components in dual cartridge check valve

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

<http://www.fordmeterbox.com>

11/12/13

Submitted By: