



# SUBMITTAL INFORMATION

## Uni-Flange® Restraint - (UFR1300-C-x-X-I style)



**SERIES 1300-C 4"-12" RESTRAINT (WITH 304 STAINLESS STEEL HARDWARE) FOR C900 PVC PIPE, C906 HDPE AND DUCTILE IRON PIPE USED WITH MECHANICAL JOINT / PUSH-ON FITTINGS**

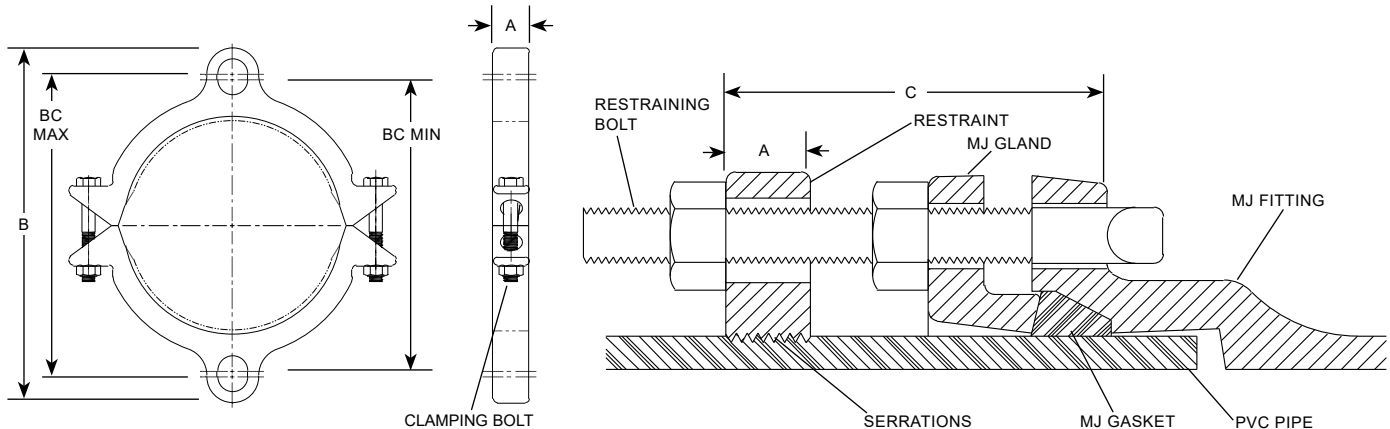

NOM PIPE SIZE	PVC PIPE WITH DUCTILE IRON PIPE OD STYLE 1300-C		A	B APPROX.	C MAX	RESTRAINING BOLTS		CLAMPING BOLTS		BC MIN	BC MAX	APPROX. WT. LBS.	✓SUBMITTED ITEM(S)
	OD (In.)	CATALOG No.				No.	SIZE	No.	SIZE				
4"	4.80	UFR1300-C-4-X-I	1-1/8"	9-1/8"	6"	2	3/4" x 7"	2	5/8" x 3-1/2"	7.13"	7.50"	8.5	
6"	6.90	UFR1300-C-6-X-I	1-1/8"	11-1/8"	6"	2	3/4" x 7"	2	5/8" x 3-1/2"	9.13"	9.50"	10.0	
8"	9.05	UFR1300-C-8-X-I	1-1/4"	14-5/8"	6"	2	3/4" x 7"	2	3/4" x 4"	11.38"	13.00"	15.5	
10"	11.10	UFR1300-C-10-X-I	1-3/8"	16-5/8"	6"	4	3/4" x 7"	2	7/8" x 5"	13.50"	15.00"	26.5	
12"	13.20	UFR1300-C-12-X-I	1-3/8"	19-1/4"	6"	4	3/4" x 7"	2	7/8" x 5"	16.13"	17.63"	28.5	

### FEATURES

- Cast ductile iron per ASTM A536 grade 65-45-12
- 360° contact and support of the pipe wall
- Ideal companion for push-on fittings with restraining ears
- T-bolts, clamping bolts and nuts (included) - Type 304 stainless steel per ASTM A193 and A194
- Rated at full-rated pressure of any class of PVC pipe, minimum 2:1 safety factor
- Rated at full-rated pressure of any class of C906 HDPE (provided an insert is used that extends completely beneath the restraint)
- Rated at 250 psi on ductile iron pipe in sizes 4" through 8" and 200 psi in size 10" and 12"
- Black e-coat epoxy coating - NSF 61 approved

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



### The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443  
Phone: 260-563-3171 / Fax: 800-826-3487  
Overseas Fax: 260-563-0167  
www.fordmeterbox.com



07/22/20

Submitted By: