



SUBMITTAL INFORMATION

Uni-Flange® Restraint - (UFR1390-S-x-X-I style)




SERIES 1390-S RESTRAINT HARNESS FOR STEEL SIZE PVC PIPE BELL JOINTS CAST SIZES 2" - 12" (WITH 304 STAINLESS STEEL HARDWARE)

1300 SPLIT RESTRAINT

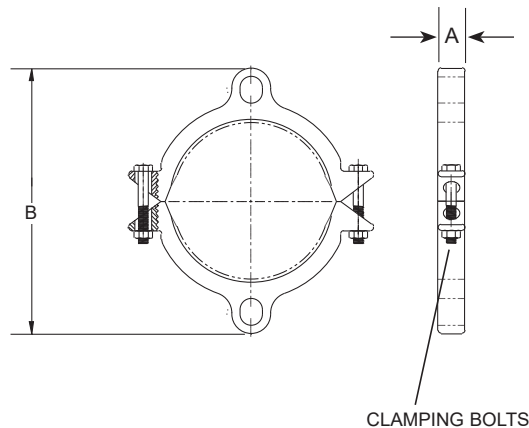

1390 ASSEMBLY

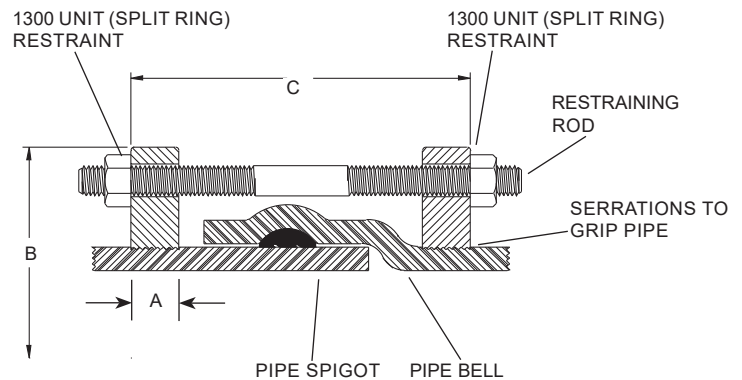

NOM PIPE SIZE	PVC PIPE WITH STEEL PIPE OD STYLE 1390-S		A	B APPROX	C MAX	RESTRAINT BOLTS / RODS		CLAMPING BOLTS PER GLAND		MAX. BELL CLEARANCE	APPROX. WEIGHT LBS.	✓ SUBMITTED ITEMS
	OD (IN.)	CATALOG No.				No.	SIZE	No.	SIZE			
2"	2.38	UFR1390-S-2-X-I	1-1/8"	6-3/8"	9"	2	5/8" x 11"	2	5/8" x 3-1/2"	4.00"	11.5	
2-1/2"	2.88	UFR1390-S-25-X-I	1-1/8"	6-7/8"	9"	2	5/8" x 11"	2	5/8" x 3-1/2"	4.63"	12.8	
3"	3.50	UFR1390-S-3-X-I	1-1/8"	7-5/8"	9"	2	5/8" x 11"	2	5/8" x 3-1/2"	5.44"	13.5	
4"	4.50	UFR1390-S-4-X-I	1-1/8"	9-1/8"	15"	2	3/4" x 17"	2	5/8" x 3-1/2"	6.63"	17.0	
6"	6.63	UFR1390-S-6-X-I	1-1/8"	11-1/8"	15"	2	3/4" x 17"	2	5/8" x 3-1/2"	8.63"	18.5	
8"	8.63	UFR1390-S-8-X-I	1-1/4"	14-7/16"	15"	2	3/4" x 17"	2	3/4" x 4"	11.88"	29.0	
10"	10.75	UFR1390-S-10-X-I	1-3/8"	16-5/8"	22"	4	3/4" x 24"	2	7/8" x 5"	14.13"	53.0	
12"	12.75	UFR1390-S-12-X-I	1-3/8"	19-1/4"	22"	4	3/4" x 24"	2	7/8" x 5"	16.70"	56.5	

FEATURES

- Cast ductile iron per ASTM A536 grade 65-45-12
- Restraining rods, clamping bolts and hardware are type 304 stainless steel per ASTM A193 and A194
- Rated at full-rated pressure of any class of PVC pipe, minimum 2:1 safety factor
- 360° contact and support of the pipe wall
- Black Armorguard e-coat epoxy coating (NSF 61 approved) with painted gray top coat for identification

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com



09/01/21

Submitted By: