



SUBMITTAL INFORMATION

Uni-Flange® Restraint - (UFR1390-S-xx-Z-U style)




SERIES 1390-S RESTRAINT HARNESS FOR STEEL SIZE PVC PIPE BELL JOINTS WITH 316 STAINLESS STEEL HARDWARE AND EPOXY COATING

1300 SPLIT RESTRAINER

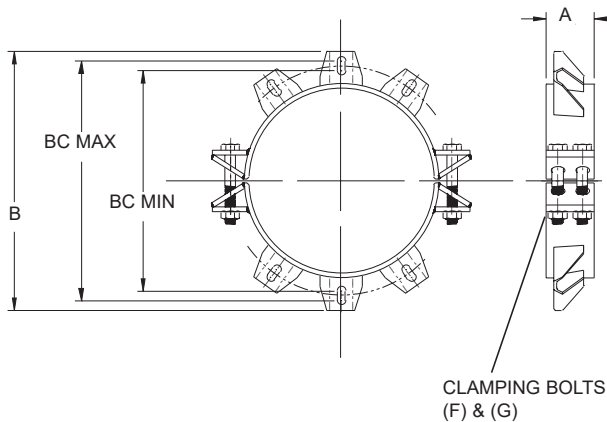

1390 ASSEMBLY

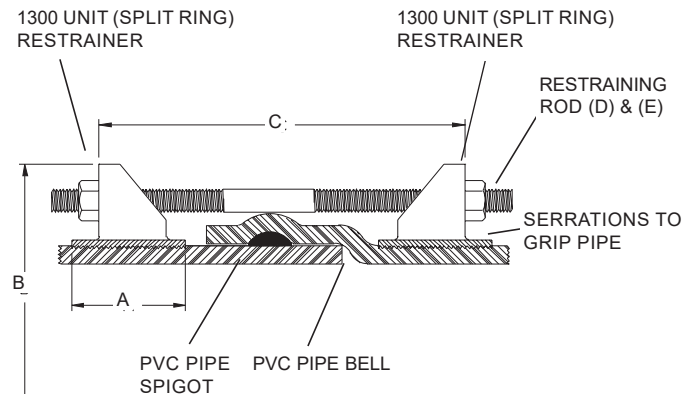

NOM PIPE SIZE (IN.)	PVC PIPE WITH STEEL PIPE OD STYLE 1390-S		A (IN.)	B APPROX (IN.)	C MAX (IN.)	RESTRAINING RODS		CLAMPING BOLTS PER GLAND		MAX BELL CLEARANCE (IN.)	APPROX WT. LBS.	✓SUBMITTED ITEM(S)
	OD (IN.)	CATALOG No.				QTY. D	SIZE E (IN.)	QTY. F	SIZE G			
14	14.00	UFR1390-S-14-Z-U	4	21-7/16	28	6	3/4 x 30	4	7/8 x 7	18.25	136	
16	16.00	UFR1390-S-16-Z-U	4	23-5/16	28	6	3/4 x 30	4	7/8 x 7	20.22	147	
18	18.00	UFR1390-S-18-Z-U	5	25-9/16	28	8	3/4 x 30	4	1 x 7	22.22	206	
20	20.00	UFR1390-S-20-Z-U	5	27-9/16	34	8	3/4 x 36	4	1 x 7	24.25	263	
24	24.00	UFR1390-S-24-Z-U	5	31-9/16	34	12	3/4 x 36	4	1 x 7	28.25	406	
30	30.00	UFR1390-S-30-Z-U	10	38-3/4	46	12	1 x 48	6	1-1/8 x 9	35.00	575	
36	36.00	UFR1390-S-36-Z-U	10	45-7/8	46	12	1 x 48	6	1-1/8 x 9	42.13	600	
42	42.00	UFR1390-S-42-Z-U	10	54-11/16	70	18	1-1/4 x 52	8	1-1/8 x 9	51.75	750	
48	48.00	UFR1390-S-48-Z-U	10	60-7/8	70	22	1-1/4 x 52	8	1-1/8 x 9	58.00	800	

FEATURES

- Fabricated out of steel per ASTM A36
- Restraining rods, clamping bolts and nuts - Type 316 stainless steel per ASTM A193 and A194
- Rated at full-rated pressure of any class of steel size PVC pipe, minimum 2:1 safety factor
- Rods (included) - Type 316 stainless steel
- Finish - Epoxy coating with gray topcoat for identification purposes - NSF 61 certified

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com



06/03/25

Submitted By: