



# SUBMITTAL INFORMATION


## Uni-Flange Split Retainer (UFR1490-D-x-XL-I style)



WEDGE ACTION SERIES 1490-D SPLIT RESTRAINT WITH SPLIT BACK UP RING ASSEMBLY FOR CAST IRON PIPE BELL JOINT

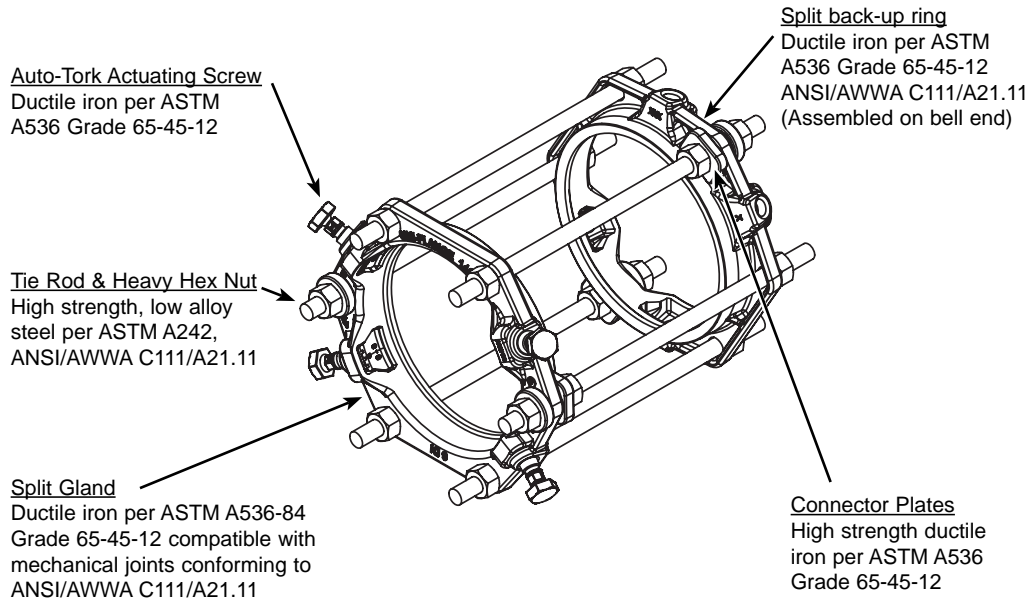

### WEDGE / ACTUATING SCREW DETAIL



#### Wedges

Ductile iron wedges are heat-treated to a hardness of 370 BHN minimum

1. Auto-tork breakaway head, 1-1/4" across the flat (same as 3/4" heavy hex nut)
2. 5/8" hex-head, operating screw
3. Rubber spacer (positions wedge during assembly)
4. Wedge

NOM. PIPE SIZE	MAX PIPE O.D.	RODS			PRESSURE RATING (PSI)	*MAX. BELL DIA.	APPROX. WT. LBS.	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
		No.	LENGTH	DIA.					
4"	5.10	4	17"	3/4"	350	6.62	20	UFR1490-D-4-XL-I	
6"	7.20	6	17"	3/4"	350	8.62	29	UFR1490-D-6-XL-I	
8"	9.40	6	17"	3/4"	350	10.88	35	UFR1490-D-8-XL-I	

\* Connecting rods WILL NOT CLEAR a pipe bell with a maximum diameter larger than the listed measurement.

### FEATURES

- Split gland: Ductile iron per ASTM A536, grade 65-45-12
- Wedge actuating screw: Ductile iron per ASTM A536, grade 65-45-12
- Split back-up ring: Ductile iron per ASTM A536, grade 65-45-12
- Wedge: Ductile iron per ASTM A536 heat treated to hardness of 370 BHN minimum
- Restraining rods and nuts: High strength low alloy steel per ASTM A242 (Optional blue fluorocarbon or stainless steel)
- Coating: Black e-coat epoxy
- New or existing installations
- 2:1 safety factor at rated working pressure; 4"-8" - 350 PSI RWP
- Imported ductile iron castings
- Assembled, inspected and packaged in the USA

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



**The Ford Meter Box Company, Inc.**  
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443  
Phone: 260-563-3171 / Fax: 800-826-3487  
Overseas Fax: 260-563-0167  
www.fordmeterbox.com

03/14/16

Submitted By: