



SUBMITTAL INFORMATION

Uni-Flange Split Retainer (UFR1490-D-xx-X-I style)



**WEDGE ACTION SERIES 1490-D SPLIT RESTRAINT (WITH TYPE 304 STAINLESS STEEL HARDWARE)
WITH SPLIT BACK UP RING ASSEMBLY FOR DUCTILE IRON PIPE BELL JOINT**

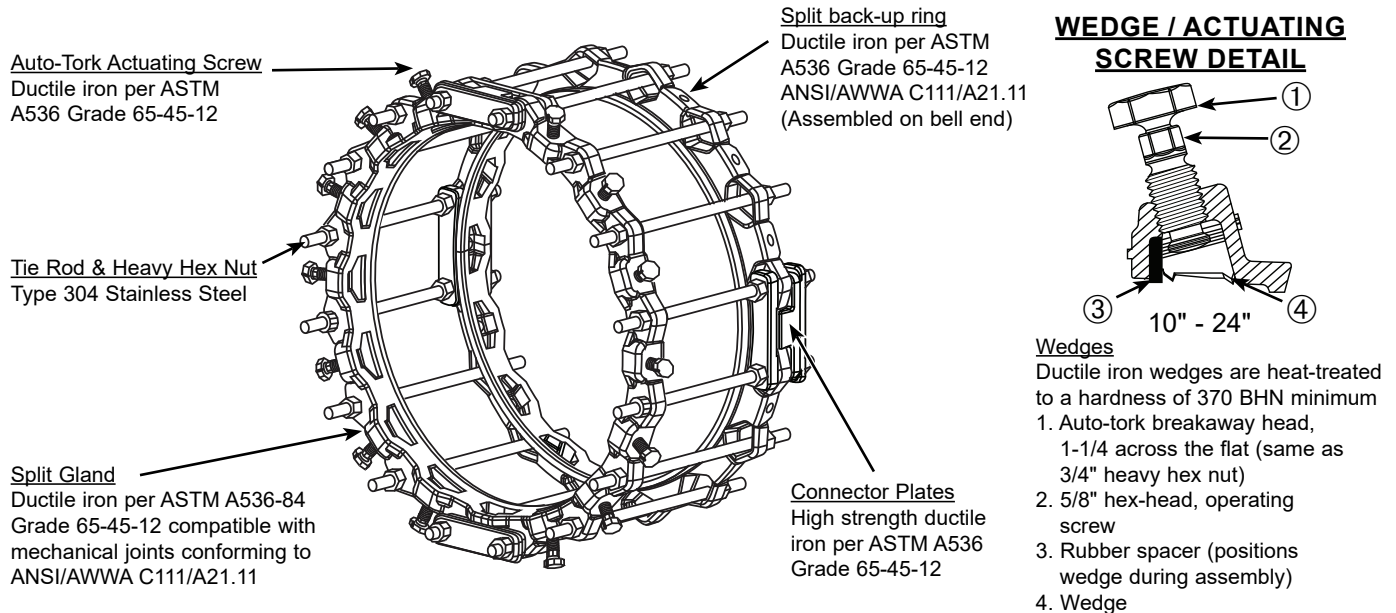

NOM. PIPE SIZE	PIPE O.D.	RODS			PRESSURE RATING (PSI)	*MAX. BELL DIA.	APPROX. WT. LBS.	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
		No.	LENGTH	DIA.					
10"	11.10	8	24"	3/4"	350	13.12	56.0	UFR1490-D-10-X-I	
12"	13.20	8	24"	3/4"	350	16.38	62.0	UFR1490-D-12-X-I	
14"	15.30	10	24"	3/4"	300	17.88	117.4	UFR1490-D-14-X-I	
16"	17.40	12	24"	3/4"	300	20.12	135.0	UFR1490-D-16-X-I	
18"	19.50	12	24"	3/4"	200	22.38	151.6	UFR1490-D-18-X-I	
20"	21.60	14	24"	3/4"	200	24.62	169.6	UFR1490-D-20-X-I	
24"	25.80	16	24"	3/4"	200	29.12	187.8	UFR1490-D-24-X-I	
30"	32.00	20	24"	1"	200	35.80	480.7	UFR1490-D-30-X-I	
36"	38.30	24	24"	1"	200	42.60	602.8	UFR1490-D-36-X-I	

* Connecting rods WILL NOT CLEAR a pipe bell with a maximum diameter larger than the listed measurement.

FEATURES

- Split gland: Ductile iron per ASTM A536, grade 65-45-12
- Wedge actuating screw: Ductile iron per ASTM A536, grade 65-45-12
- Split back-up ring: Ductile iron per ASTM A536, grade 65-45-12
- Wedge: Ductile iron per ASTM A536 heat treated to hardness of 370 BHN minimum
- Restraining Rods and Nuts: Type 304 Stainless Steel
- Coating: Black e-coat epoxy
- New or existing installations
- 2:1 safety factor at rated working pressure; 10"-12" - 350 PSI RWP, 14"-16" - 300 PSI RWP, 18"-36" - 200 PSI RWP
- Imported ductile iron castings
- Assembled, inspected and packaged in the USA

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

08/24/18

Submitted By: