



SUBMITTAL INFORMATION

Ball Valve Branch Assembly - (UVB13-xxW-NL style)



FEMALE IRON PIPE THREAD INLET BY TWO METER SWIVEL NUT OUTLETS

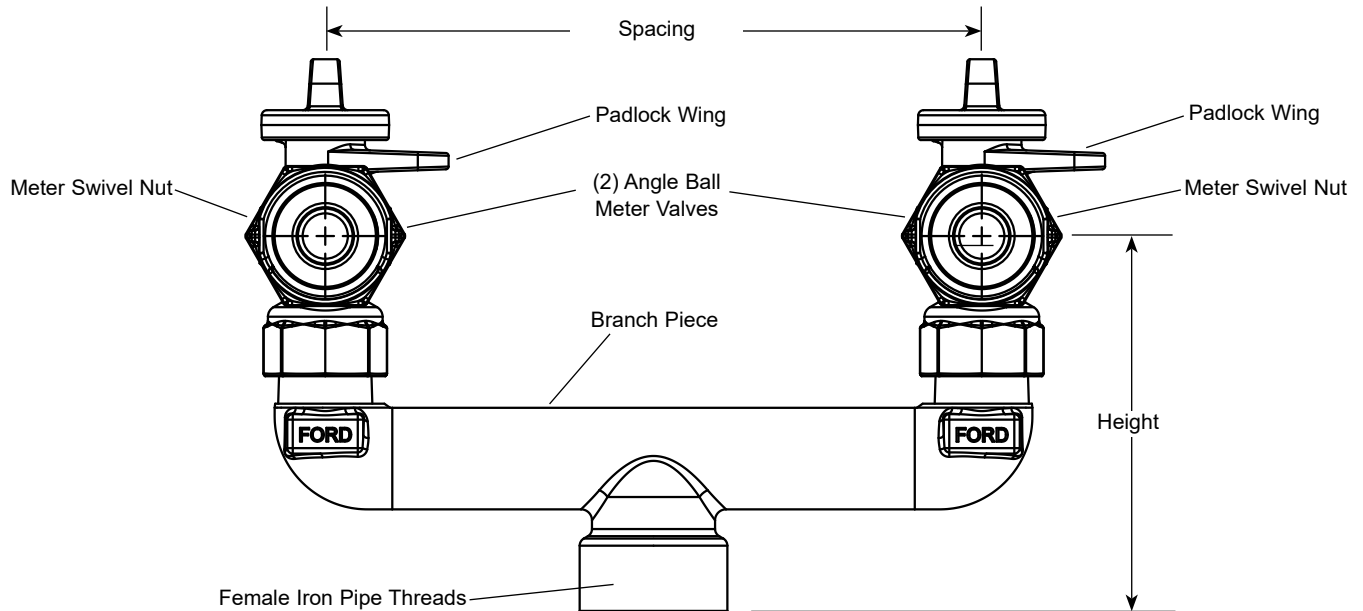

Due to design variations related to sizing, items may differ from images above.

SERVICE SIZE	METER SIZE	SPACING	HEIGHT	APPROX. Wt. LBS.	COMPONENTS		ASSEMBLY CATALOG NUMBER	✓ SUBMITTED ITEM(S)
					BRANCH PIECE	VALVES (2)		
3/4"	5/8"	7-1/2"	4-5/16"	4.4	U18-33-NL	BA13-231W-NL	UVB13-31W-NL	
3/4"	5/8" x 3/4" or 3/4"	7-1/2"	4-5/16"	4.4	U18-33-NL	BA13-232W-NL	UVB13-32W-NL	
1"	5/8"	7-1/2"	4-5/16"	4.4	U18-43-NL	BA13-231W-NL	UVB13-41W-NL	
1"	5/8"	6-1/2"	4-5/16"	4.2	U18-43-65-NL	BA13-231W-NL	UVB13-41W-65-NL	
1"	5/8" x 3/4" or 3/4"	7-1/2"	4-5/16"	4.4	U18-43-NL	BA13-232W-NL	UVB13-42W-NL	
1"	5/8" x 3/4" or 3/4"	6-1/2"	4-5/16"	4.2	U18-43-65-NL	BA13-232W-NL	UVB13-42W-65-NL	
1"	5/8" x 3/4" or 3/4"	14"	4-5/16"	5.4	U18-43-14-NL	BA13-232W-NL	UVB13-42W-14-NL	

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- All branch valve assemblies have padlock wings
- Meter gaskets are furnished with all branch valve assemblies
- Meets high pressure service line requirements of AWWA Standard C800
- Conforms to AWWA C700 for meter threads

Optional full 360° tee-head rotation. Add "R" to the catalog number.

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

01/22/20

Submitted By: