



SUBMITTAL INFORMATION

70 Series Coppersetter - (VB72-xxW-77-xx-NL style)

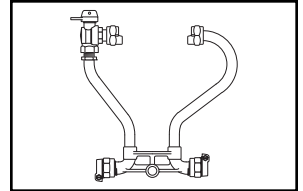

ANGLE BALL VALVE BY METER NUT (5/8" X 3/4" METER)

PACK JOINT FOR PVC PIPE INLET AND OUTLET

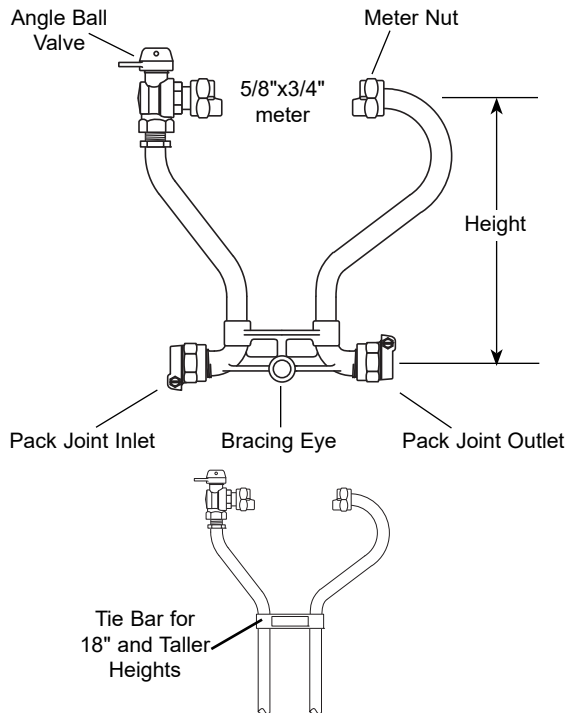

Coppersetter Part Number

HEIGHT (INCHES)	APPROX. WT. LBS.	CATALOG NUMBER (INSERT SERVICE LINE CONN. SIZE)	✓ SUBMITTED ITEM(s)
7	4.3	VB72-7W-77-xx-NL	
9	4.5	VB72-9W-77-xx-NL	
12	4.7	VB72-12W-77-xx-NL	
15	4.9	VB72-15W-77-xx-NL	
18	5.6	VB72-18W-77-xx-NL	
21	5.8	VB72-21W-77-xx-NL	
24	6.1	VB72-24W-77-xx-NL	
27	6.3	VB72-27W-77-xx-NL	
30	6.6	VB72-30W-77-xx-NL	
33	6.9	VB72-33W-77-xx-NL	
36	7.1	VB72-36W-77-xx-NL	
39	7.4	VB72-39W-77-xx-NL	
42	7.7	VB72-42W-77-xx-NL	

Service Line Size

INLET	OUTLET	SERVICE LINE CONN. SIZE	✓ SUBMITTED ITEM(s)
3/4" (PVC) P.J.	3/4" (PVC) P.J.	33	
1" (PVC) P.J.	1" (PVC) P.J.	44	

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)
- Certified to NSF/ANSI Standard 61 and NSF/ANSI Standard 372 where applicable
- Copper conforms to ASTM B75 or B88, UNS C12200
- All Ford® Setters are assembled with lead-free solder
- Saddle nuts hold the meter in place for tightening
- Bracing eye is standard on all 70 Series Coppersetters
- Tie bar is standard for 18" and taller Coppersetter heights (72 Series)
- 13/16" copper risers provide more flow capacity

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



The Ford Meter Box Company, Inc.
P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
Phone: 260-563-3171 / Fax: 800-826-3487
Overseas Fax: 260-563-0167
www.fordmeterbox.com

08/24/21

Submitted By: